


PLAN  
N.T.S.

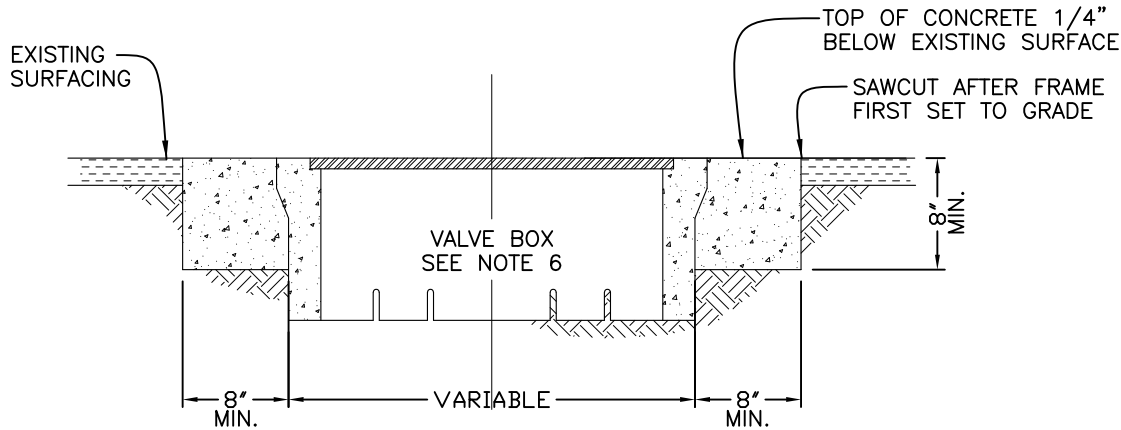

ELEVATION  
N.T.S.

NOTES

1. DIMENSIONS TO BE SAME FOR ALL SIZES OR TYPES OF OPENINGS.
2. CONCRETE MAY BE DELETED ON ROAD MIX STREETS UPON APPROVAL OF INSPECTOR.
3. CONCRETE TO BE CLASS "A" (SIX SACK).
4. CONCRETE TO BE BARRICADED FOR THREE DAYS AFTER POURING.
5. CONCRETE CURE TO BE IN ACCORDANCE WITH SECTION 90-7 "CURING CONCRETE" OF THE STANDARD SPECIFICATIONS PER COUNTY/CITY MOST CURRENT EDITION.
6. USE OLDCASTLE/CHRISTY BOXES AND LIDS AS FOLLOWS:  
 3/4" SERVICE B1017 BOX W/B1017-51GH LID  
 1" SERVICE B1324 BOX W/B1324-51GH LID  
 1-1/2" - 2" SERVICE B1730 BOX W/B1730-51GH LID  
 3" - 4" SERVICE B3048 BOX W/B3048-53JH LID
7. SEND RFI TO OMWC FOR LARGER OR MULTIPLE APPLICATIONS.
8. ALL BOXES & LIDS SHALL BE PURPLE - OMWC APPROVED COLOR AND MARKED "IRRIGATION".

REV. DATE: 2/18/19

OILDALE MUTUAL WATER CO.

NON-POTABLE/IRRIGATION METER  
BOX IN TRAFFIC AREA

DATE: 8/1/13

PLATE No. IRR-12B